

# Energy Management

## Modular Smart Power Quality Analyzer

### Type WM5-96

CARLO GAVAZZI



- MODBUS RTU and TCP, JBUS protocol, iFIX SCADA compatibility
- Real time clock function (without back-up)
- Up to 12 optional digital inputs (sync function, remote digital input control)
- Up to 16 optional digital outputs (pulse, alarm, remote control)
- 16 freely configurable alarms with OR/AND logic linkable with up to 4 relay outputs and up to 16 open collector outputs
- Up to 8 optional analogue outputs (+20mA, +10VDC, +/- 5mA)
- Universal power supply: 18-60VAC/VDC, 90-260 VAC/VDC
- Front protection degree: IP 65, NEMA4x, NEMA12

- Class 0.2 (current/voltage)
- ARM® powered
- Back-lighted graph display (128x64 dots)
- Bargraph indication of instantaneous power (kW sys)
- Front size: 96x96 mm
- Measurement of single phase and system instantaneous variables: W, var, VA, PF, VLL, VLN, A<sub>L</sub>, A<sub>n</sub>, Hz, THD, ASY VLL, ASY VLN (for all measurements max, min, dmd/AVG and max dmd/AVG values)
- Measured energies (imported/exported): kWh and kvarh
- Current and voltage inputs with autoranging capability
- 4x4 DGT instantaneous variable read-out
- 4x9 DGT total energies read-out
- 4x9 DGT partial energies read-out
- Energy measurements according to ANSI C12.20, CA 0.5, EN62053-22 CL 0.5S and ANSI C12.1, EN62053-23 CL 2
- 4 total 3-phase, 48 partial 3-phase and 12 total single phase independent energy meters to be used as single, dual, multi-time tariff management
- Display refresh rate: 10 time / sec
- Harmonic distortion analysis (FFT) up to the 63<sup>rd</sup> harmonic with graphic and numeric indication (current and voltage)
- Harmonics source detection
- Data stamping of up to 10,000 events: alarm, min, max, digital input status, digital output status as remote control, resets
- 4 independent communication ports:  
optical front communication port (ANSI C12.18)  
optional RS 422/485 serial port, optional RS232 + real time clock function, optional Ethernet port

## Product Description

3-phase utility grade power quality analyzer. Particularly recommended for the measurement of the main electrical variables.

Housing for panel mounting, with optical communication

port (according to the ANSI standards), RS485/RS232 or Ethernet communication ports, pulse and alarm outputs. Parameters programming and data reading by means of Wm5Soft.

## How to order

**WM5-96** see next page

## How to order

**Wm5Soft**

Parameters programming and data reading by means of Wm5Soft.

## Modules Combination

Description	Part N.	Slot A	Slot B	Slot C	Slot D	Slot E
WM5-96 base with ANSI local port	AD2001					
WM5-96 base without local port	AD2000					
Power supply (18-60VAC/DC)	AP1021					
Power supply (90-260VAC/DC)	AP1020					
Measuring input (AV5: 400/690VL-L)	AQ2030					
Measuring input (AV6: 120/208VL-L)	AQ2031					
RS485 port (9 600 bps)	AR1034		1-port			
RS485 port (115,200 bps)	AR2040		1-port			
Ethernet/Internet port	AR1061	1-port				
Analogue output (20mA DC)	AO2050	2-out	2-out			
Analogue output (10V DC)	AO2051	2-out	2-out	2-out	2-out	
Analogue output (+/-5mA DC)	AO2052	2-out	2-out	2-out	2-out	
Relay output	AO1058	1-out	1-out	1-out	1-out	
Relay output	AO1035			2-out	2-out	
Open collector output	AO1059	1-out	1-out	1-out	1-out	
Open collector output	AO1036	2-out	2-out	2-out	2-out	
Open collector output	AO1037	4-out	4-out	4-out	4-out	
Digital inputs	AQ1038	3-in	3-in	3-in	3-in	
Digital inputs + Aux	AQ1042	3-in	3-in	3-in	3-in	
RS232 port + RTC (9 600 bps)	AR1039					1-port


## How to order WM5 96

**Minimum modules for a basic unit on grey background**

Ordering key (fully assembled instrument):


Description	Ch	Part No.	Legend
<b>Model</b>			
WM5-96 with optical port		AD2001	WM5 96
ANSI C12.18 type			
WM5-96 without optical port		AD2000	WM5 96
<b>Range code+sys (meas. inputs)</b>			
400/690VL-L 1/5A (10A)		AQ2030	AV5.3
120/208VL-L 1/5A (10A)		AQ2031	AV6.3
<b>Power supply</b>			
18-60VAC/DC power supply		AP1021	L
90-260VAC/DC power supply		AP1020	H
None			
Ethernet/Internet port	1	AR1061	XX
Digital inputs	3	AQ1038	E2
Digital inputs + aux	3	AQ1042	D1
Open collector output	4	AO1037	D2
Open collector output	2	AO1036	O4
Open collector output	1	AO1059	O2
Relay output	1	AO1058	O1
Analogue output 20mA	2	AO2050	R1
Analogue output 10VDC	2	AO2051	B1
Analogue output +/-5mA	2	AO2052	W1
			B2
None			
Digital inputs	3	AQ1038	XX
Digital inputs + aux	3	AQ1042	D1
Open collector output	4	AO1037	D2
Open collector output	2	AO1036	O4
Open collector output	1	AO1059	O2
Relay output	1	AO1058	O1
Analogue output 20mA	2	AO2050	R1
Analogue output 10VDC	2	AO2051	B1
Analogue output +/-5mA	2	AO2052	W1
RS485 9600bps	1	AR1034	B2
RS485 115200bps	1	AR2040	S1
			S2
None			
Digital inputs	3	AQ1038	XX
Digital inputs + aux	3	AQ1042	D1
Open collector output	4	AO1037	D2
Open collector output	2	AO1036	O4
Open collector output	1	AO1059	O2
Relay output	1	AO1058	O1
Relay output	2	AO1035	R2
Analogue output 10VDC	2	AO2051	W1
Analogue output +/-5mA	2	AO2052	B2
None			
Digital inputs	3	AQ1038	XX
Digital inputs + aux	3	AQ1042	D1
Open collector output	4	AO1037	D2
Open collector output	2	AO1036	O4
Open collector output	1	AO1059	O2
Relay output	1	AO1058	O1
Relay output	2	AO1035	R2
Analogue output 10VDC	2	AO2051	W1
Analogue output +/-5mA	2	AO2052	B2
Utility grade with optical port			
RS232 + RTC (utility grade)	1	AR1039	XX
"Type approval" Canada for further "Revenue approval" process (*)			SX
RS232+RTC + "XU" option	1	AR1039	XU
Utility grade without optical port			SU
RS232 + RTC (utility grade) without optical port	1	AR1039	YY
			SY
OPTIONS			
SLOT E			

WM5 96 AV53 H XX XX XX XX XX

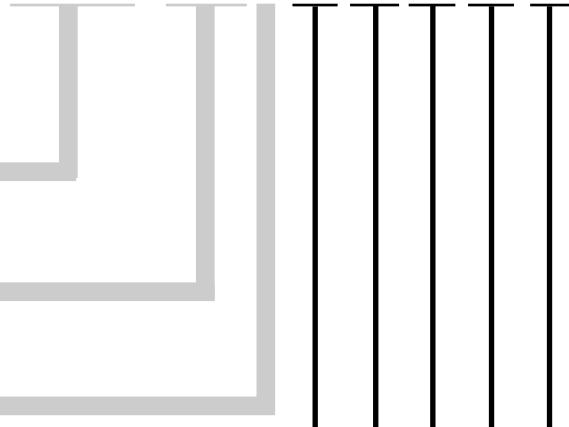

Example of which modules to order for:  
WM5-96 AV53 H B1 S1 R2 O2 SX

Bill of material	Ordering No.
WM5 96	AD2001
AV53 measuring inputs (400/690VL-L)	AQ2030
90-260VAC/DC power supply	AP1020
Analogue output 20mA (2 channels)	AO2050
RS485 serial port 9600 bps	AR1034
Relay output (2 channels)	AO1035
Open collector (2 channels)	AO1036
RS232 port+RTC	AR1039

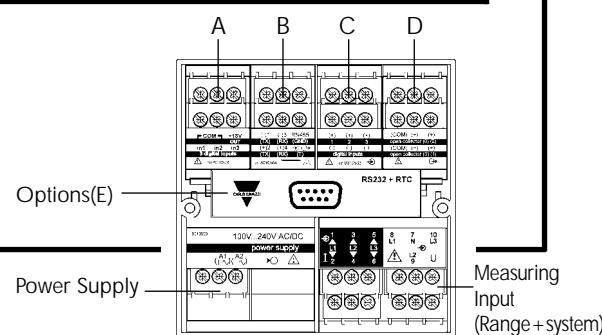

(\*) Available only for the assembled meters having the 2 possible minimum base configuration, respectively made up of:

- display module + power supply module H + AV5 3 special mode
- display module + power supply module H + AV6 3 special mode.

## Input specifications

<b>Number of analogue inputs</b>		
Current	1 (1-phase; system code: 3) 3 (3-phase; system code: 3)	Energies (@ 20°C ± 5°C, R.H. ≤ 75%)
Voltage	1 (1-phase; system code: 3) 4 (3-phase; system code: 3)	Active: class 0.5 according to EN62053-22, ANSI C12.20 Reactive: class 2 according to EN62053-23, ANSI C12.1
<b>Digital inputs (on request)</b>		In: 5A, Imax: 10A 0.1In: 500mA, Start-up current: 5mA Un: 400/690V <sub>LL</sub> (AV5) Un: 120/208V <sub>LL</sub> (AV6) 1% FS (FS: 100%) phase: ±2°; Imin: 5mA <sub>RMS</sub> ; Imax: 15Ap; Umin: 30VRMS; Umax: 500Vp
AQ1038 Purpose	Up to 12 No. of inputs: 3 (voltage-free) "dmd" measurements synchronisation. Tariff selection: energy. Contact status reading. Clock synchronisation. <8mA/ 17.5 to 25VDC Number of inputs: 3 + excitation output "dmd" measurements synchronisation. Tariff selection: energy. Contact status reading. Clock synchronisation.	Harmonic distortion (@ 20°C ± 5°C, R.H. ≤ 75%)
Contact measuring current AQ1042	<8mA/ 17.5 to 25VDC Number of inputs: 3 + excitation output "dmd" measurements synchronisation. Tariff selection: energy. Contact status reading. Clock synchronisation. 16V<+Aux<24VDC Max 15mA 15mA	
Purpose		Temperature drift ≤ 200ppm/°C (AV), ≤ 300ppm/°C (all the other measurements)
Excitation output Contact measuring current	Max 1kΩ Min 100kΩ see "Insulation between inputs and outputs" table	Sampling rate 6400 samples/s @ 50Hz 7680 samples/s @ 60Hz
Common characteristics		Display Graph LCD backlit (128x64 dots). Read-out for the instantaneous variables: 4x4 digit Total energies: 4x9 digit; Partial energies: 4x9 digit
Close contact resistance		Display refresh time 100ms
Open contact resistance		Max. and min. indication Max. 9999 (999,999,999), Min. -9999 (-999,999,999)
Insulation		Front LED Red Blinking light in case of virtual alarm Fixed light in case of digital output activation (alarm)
<b>Accuracy</b> (display, RS232, RS485)		
Current (A <sub>L1</sub> , A <sub>L2</sub> , A <sub>L3</sub> ) (@20°C ± 5°C, R.H. ≤ 75%)	In: 5A, If.s.: 10A Un: see voltage ranges below from 0.05In to Imax: ±(0.2%RDG+2DGT) from 0.01In to 0.05In: ±(0.5%RDG+2DGT) ±0.5% RDG (0.2 to 2 In) @ 40 to 100 Hz	Measurements Current, voltage, power, energy, power factor, frequency, harmonic distortion (see "Display Pages"). TRMS measurement of a distorted wave (voltage/current) .
Current (A <sub>n</sub> )		Coupling type Direct.
Voltage (@20°C ± 5°C, R.H. ≤ 75%) range AV5:	400/690V <sub>LL</sub> AC V <sub>L-N</sub> : 185 V to 460 V V <sub>L-L</sub> : 320 V to 800 V ±(0.2%RDG+1DGT) 120/208V <sub>LL</sub> AC V <sub>L-N</sub> : 45 V to 145 V V <sub>L-L</sub> : 78 V to 250 V ±(0.2%RDG+1DGT) Includes also: frequency, power supply and output load influences	Crest factor < 3, max 10A peak
range AV6:	±0.1% RDG (40 to 440 Hz) 0.05In to Imax, PF 1: ±(0.5%RDG+1DGT) 0.01In to 0.05In, PF 1: ±(1%RDG+1DGT) 0.1In to Imax, PF 0.5L, PF 0.8C: ±(0.6%RDG+1DGT) 0.02In to 0.1In, PF 0.5L, PF 0.8C: ±(1%RDG+1DGT)	Input impedance 400/690V <sub>LL</sub> (AV5) 120/208V <sub>LL</sub> (AV6) Current
Frequency Active power and apparent power (@ 20°C ± 5°C, R.H. ≤ 75%)	0.01In to 0.05In, PF 1: ±(1%RDG+1DGT) 0.1In to Imax, PF 0.5L, PF 0.8C: ±(0.6%RDG+1DGT) 0.02In to 0.1In, PF 0.5L, PF 0.8C: ±(1%RDG+1DGT)	Frequency 40 to 440 Hz
Reactive power (@ 20°C ± 5°C, R.H. ≤ 75%)	0.1In to Imax, senφ 0.5L/C: ±(2%RDG+1DGT) 0.05In to 0.1In, senφ 0.5L/C: ±(2.5%RDG+1DGT) 0.05In to Imax, senφ 1: ±(2%RDG+1DGT) 0.02In to 0.05In, senφ 1: ±(2.5%RDG+1DGT)	Overload protection (max values) AV5: 460V <sub>LN</sub> , 800V <sub>LL</sub> /10A AV6: 145V <sub>LN</sub> , 250V <sub>LL</sub> /10A AV5: 800V <sub>LN</sub> , 1380V <sub>LL</sub> /36A AV6: 240V <sub>LN</sub> , 416V <sub>LL</sub> /36A For 500ms: voltage/current

## Output specifications

### Analogue Outputs (on request)

Number of outputs	Up to 8 (max 4 x 20mA + 4 x 10VDC or 4 x 20mA + 4 x ±5mA or 8 x 10VDC or 8 x ±5mA)
Accuracy (@25°C ±5°C, RH.≤60%)	±0.1%FS (20mA or 10VDC) ±0.3%FS (±5mA), FS=10mA
Range	0 to 20mA or 0 to 10 VDC or ±5mA
Scaling factor:	Programmable within the whole range of retransmission; it allows the retransmission management of all values from: 0 and 20 mA, 0 and 10VDC, or -5mA and +5mA
Response time	≤ 400 ms typical (filter excluded)
Ripple	≤1% (according to IEC 60688-1, EN 60688-1)
Total temperature drift Load: 20 mADC 10 VDC ±5 mA	≤ 500 ppm/°C ≤ 350 Ω ≥ 10kΩ ≤ 1400Ω
Insulation	see "Insulation between inputs and outputs" table

### Ethernet/Internet port

Protocols	Modbus TCP
IP configuration	Static IP
TCP port	Selectable (default 502)
Client connections	Max 5 simultaneously
Connections	RJ45 10/100 Base T

### Digital outputs (on request)

Pulse type	Up to 16
Number of outputs	Programmable from 1.000 to 1000 pulses per Wh/varh (total and partial)
Type	Outputs connectable to the total and/or partial energy meters (Wh/varh)
Pulse duration	≥ 100ms, < 120msec (ON), ≥ 100ms (OFF)
Alarm type	according to EN62053-31

Number of outputs	up to 16, independent
Alarm modes	Up alarm, down alarm, in window alarm, out window alarm. All of them can be used with start up deactivation function and/or latch.
	All the alarms can be connected to all variables (see the table "List of the variables that can be connected to").

### Optical communication port

According to ANSI C12.18

### RS422/RS485 port (on request)

Connections	Multidrop bidirectional (static and dynamic variables) 2 or 4 wires, max. distance 1000m, termination directly on the module
Addresses	1 to 247, selectable by key-pad
Protocol	MODBUS RTU /JBUS,
Data (bidirectional)	
Dynamic (reading only)	All display variables (see also the table, "List of the variables that can be connected to" ...) All configuration parameters, reset of energy, activation of digital output Stored energy (EEPROM) max. 999.999.999 kWh/kvarh
Static (writing only)	1-start bit, 8-data bit, no parity/even parity, odd parity, 1 stop bit 9.6k, 19.2k, 38.4k, 115.2k bit/s selectable bauds
Data format	1-start bit, 8-data bit, no parity/even parity, odd parity, 1 stop bit 9.6k, 19.2k, 38.4k, 115.2k bit/s selectable bauds
Baud-rate	9.6k, 19.2k, 38.4k, 115.2k bit/s selectable bauds
Insulation	see "Insulation between inputs and outputs" table

### Static (digital) outputs

Purpose	(on request) For pulse outputs or for alarm outputs
Signal	V <sub>ON</sub> 1.2 VDC/ max. 100 mA V <sub>OFF</sub> 30 VDC max. see "Insulation between inputs and outputs" table
Insulation	

### Relay (digital) outputs

Purpose	(on request) For alarm outputs or for pulse outputs
Output type	Relay SPDT AC 1-8A, 250VAC DC 12-5A, 24VDC AC 15-2.5A, 250VAC DC 13-2.5A, 24VDC
Insulation	see "Insulation between inputs and outputs" table
Electrical life:	≥ 10 <sup>5</sup> operations (@ 8A, 250 V, PF 1)
Mechanical life:	≥ 30 - 10 <sup>6</sup> operations

### RS232 output (on request)

Connections	Bidirectional (static and dynamic variables)
Data format	3 wires, max. distance 15m, 1-start bit, 8-data bit, no parity, even parity, odd parity, 1 stop bit
Baud-rate	9.6k bit/s
Protocol	MODBUS RTU /JBUS
Other data	as for RS422/485

## Software functions

<b>Password</b>	Numeric code of max 4 digits from 0 to 1000; 2 protection levels of the programming data Password "0": no protection Password from 1 to 1000: all data are protected.  <b>System selection</b> System 1 System 2, unbalanced System 3, balanced System 3, unbalanced	<b>Data stamping</b> Type of data  Number of events Data management type: Data storage type  <b>Displaying</b>	Alarm, min, max, digital input status, digital output status as remote control, resets. All events are stored with date (dd:MM:yy) and hour (hh:mm:ss) reference Up to 10,000 FIFO Data flash  4 variables per page 1 page that can be laid out by the user Up to 36 pages Up to 28 pages depending on the selected tariff mode. Displaying of the consumed energy of the previous 12 months. 10,000 events.
<b>Transformer ratio</b>	CT up to 30 kA (6000 max) VT (PT) up to 600 kV (6000 max)	Energy meters	
<b>Filters</b> Filter operating range  Filtering coefficient Filter action	0.1 to 100% of the input electrical scale. 1 to 255 Display, alarms, serial outputs (fundamental variables: V, A, W and their derived ones).	Stored events	
<b>Alarms</b> Working mode	"OR" or "AND" or "OR+AND" functions (see "Alarm parameter and logic" page). Freely programmable on up to 16 alarms. The alarms can be connected to any variables available in the table "List of the variables that can be connected to"	Display language	Selectable: English, Italian, French, German, Spanish
<b>Reset</b>	By means of the key-pad or of the configuration software, it is possible to reset the following data: - all the min, max, dmd, dmd-max values. - total and partial counters. - latch alarms. - all the events.		

## Wm5Soft parameter programming and variable reading software

<b>Wm5Soft</b>	Multi-language software (Italian, English, French, German, Spanish) for variable reading, instrument calibration and parameters programming. The program runs under Windows /98/98SE/2000/NT/XP. Three different working modes can be selected:	- management of local RS232 (MODBUS); - management of local optical port (MODBUS); - management of a local RS485 network (MODBUS); In pre-formatted XLS files (Excel data base). Manual or automatic at programmable timings.
Working mode	Data Storing  Data Transfer	

## Time period management

<b>Meters</b>		<b>Energy Meters</b>	
Total Partial and multitariff	4 (9-digit) 48 (9-digit)	Total energy meters	4 (+kWh, +kvarh, -kWh, -kvarh) It is possible to divide each energy meter here above listed in 3 additional energy meters (1 for each phase "L1-L2-L3")
<b>Tariffs</b>	Up to 12	Monthly energy meters	48 (energy meters for each month: "+kWh, +kvarh, -kWh, -kvarh")
<b>Time periods</b>		Partial energy meters	16 (using digital inputs: max 4 tariffs).
Number of periods	Up to 24 per day Up to 100 different days per year		48 (using the internal clock: max 12 tariffs)
<b>Pulse output</b>	Connectable to total and/or partial meters (multitariff)		
<b>Energy meter recording</b>	Consumption history by recording of the monthly energy meters (12 previous months). Recording of total and partial energy meters. Energy meter recording (EEPROM) Max. 999,999,999 kWh/kvarh.	<b>GAS/WATER meters</b>	GAS ( $m^3$ ) or WATER (hot-cold $m^3$ ) or remote heating (kWh) meters

## Harmonic distortion analysis

<b>Analysis principle</b>	FFT	
<b>Harmonic measurement</b>		possible to know if the distortion is absorbed or generated. Note: if the system has 3 wires the angle cannot be measured.
Current Voltage	Up to the 63 <sup>rd</sup> harmonic Up to the 63 <sup>rd</sup> harmonic	
<b>Type of harmonics</b>	THD (V <sub>L1</sub> and V <sub>L1-N</sub> ) THD odd (V <sub>L1</sub> and V <sub>L1-N</sub> ) THD even (V <sub>L1</sub> and V <sub>L1-N</sub> ) The same for the other phases: L <sub>2</sub> , L <sub>3</sub> . THD (A <sub>L1</sub> ) THD odd (A <sub>L1</sub> ) THD even (A <sub>L1</sub> ) The same for the other phases: L <sub>2</sub> , L <sub>3</sub> .	Harmonic details  The harmonic contents is displayed as a graph showing the whole harmonic spectrum. This value is also given as a numerical information: THD % / RMS value THD even % / RMS value THD odd% / RMS value single harmonics in % / RMS value
<b>Harmonic phase angle</b>	The instrument measures the angle between the single harmonic of "V" and the single harmonic of "I" of the same order. According to the value of the electrical angle, it is	System  The harmonic distortion can be measured in single-phase, 3-wire or 4-wire systems. Tw: 0.02 sec@50Hz without filter

## General Specifications

<b>Operating temperature</b>	-10° to +45°C (14° to 113°F) (R.H. < 90% non-condensing)	<b>Pulse voltage (1.2/50μs)</b>	EN61000-4-5
<b>Limit range of operating temp.</b>	-20° to +55°C (-4° to 131°F) (R.H. < 90% non-condensing)	<b>Safety standards</b>	IEC60664, IEC61010-1 EN60664, EN61010-1
<b>Storage temperature</b>	-30° to +60°C (-22° to 140°F) (R.H. < 90% non-condensing)	<b>Measurement standards</b>	IEC60688, EN60688, EN62053-22, EN62053-23, ANSI C12.20, ANSI C12.1
<b>Installation category</b>	III	<b>Approvals</b>	CE, cURus and CSA
<b>Pollution degree</b>	2	<b>Connections 5(6) A</b>	Screw-type max. 2.5 mm <sup>2</sup> wires (2x 1.5mm <sup>2</sup> ) Max. screws tightening torque: 0.5 Nm
<b>Altitude</b>	up to 2000m (6560 feet) above sea-level	<b>Housing</b>	96x96x140 mm ABS, self-extinguishing: UL 94 V-0
<b>Insulation reference voltage</b>	300 VRMS to ground (AV5 input)	<b>Dimensions</b>	
<b>Dielectric strength</b>	4kVAC <sub>RMS</sub> (for 1 min)	<b>Material</b>	
<b>Noise Rejection CMRR</b>	100 dB, 48 to 62 Hz	<b>Protection degree</b>	Front: IP65, NEMA4x, NEMA12
<b>EMC</b>		<b>Weight</b>	Approx. 600 g (packing included)
Emissions	EN61000-6-3, EN60688 residential environment, commerce and light industry		
Immunity	EN61000-6-2 industrial environment. ANSI/IEEE C37.90-1989 (surge, withstand and fast transient test)		


## Supply specifications

<b>AC/DC voltage</b>	90 to 260V (standard) 18 to 60V (on request)	<b>Power consumption</b>	≤ 30VA/12W (90 to 260V) ≤ 20VA/12W (18 to 60V)
----------------------	-------------------------------------------------	--------------------------	---------------------------------------------------


## Revenue approval settings

- The access to the programming parameters via front key pad and/or serial communication ports is locked.
- The front key pad (up and down keys) allows the displaying of the variables only, while the communication ports allows the transmission of the variables only.
- A proper "instrument settings" form must be filled up by the user before equipment supplying.
- WM5-96 is supplied with the desired modules plugged and sealed in the proper slots.
- WM5-96 fulfills: the ANSI/IEEE C12.20-1998 requirements;

the CAN3-C17-M84 requirements;  
and can be certified according to:  
C12.20-1998, class 0.5 (independent labs);  
AE-0924 Industry Canada Approval.  
In this case there are 2 base configurations:  
1. display module + measuring input module AV5 3 + power supply module H.  
2. display module + measuring input module AV6 3 + power supply module H.

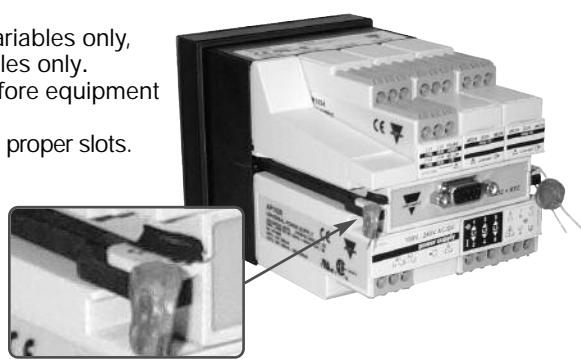


## Alarm parameters and logic



- Block enable.
- Controlled variable (VLN, ...).
- Alarm type (up, down, window int, window ext).
- Activation function.
- Latch




- SET 1.
- SET 2.
- ON delay.
- OFF delay
- Logical function (AND, OR).
- Digital output (1 to 16).

**A, B, C... up to 16**  
parameter control blocks.

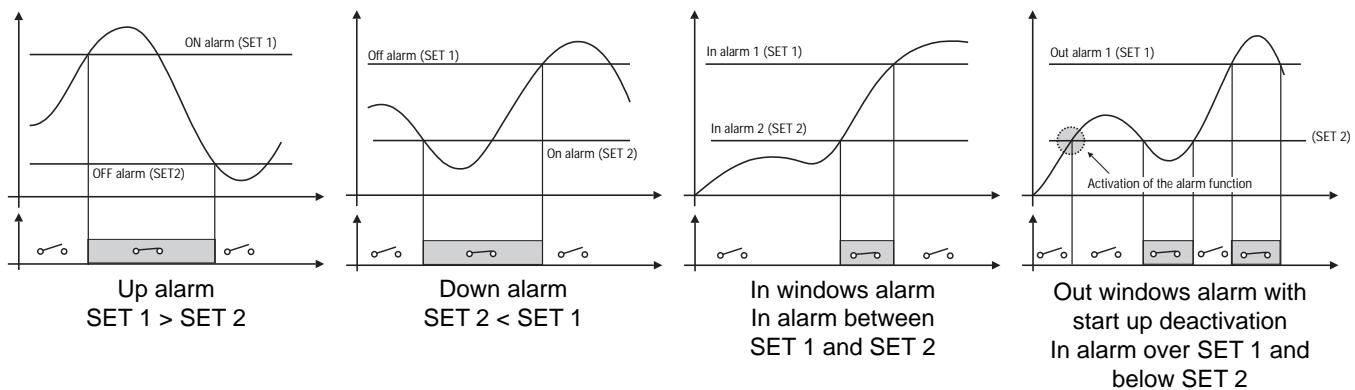

**Note:** any alarm working mode can be linked to the "Activation" function which disables only the first alarm at the power on of the instrument. All the alarms can be used with the latch function.

### AND/OR logical alarm examples:

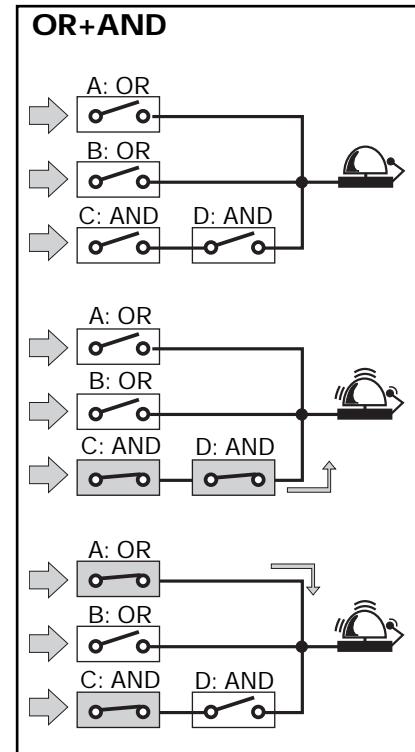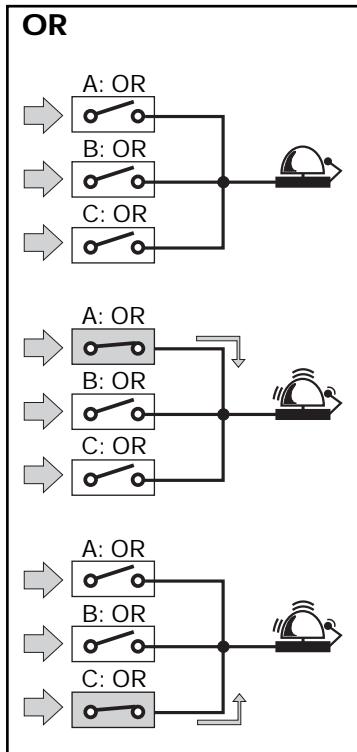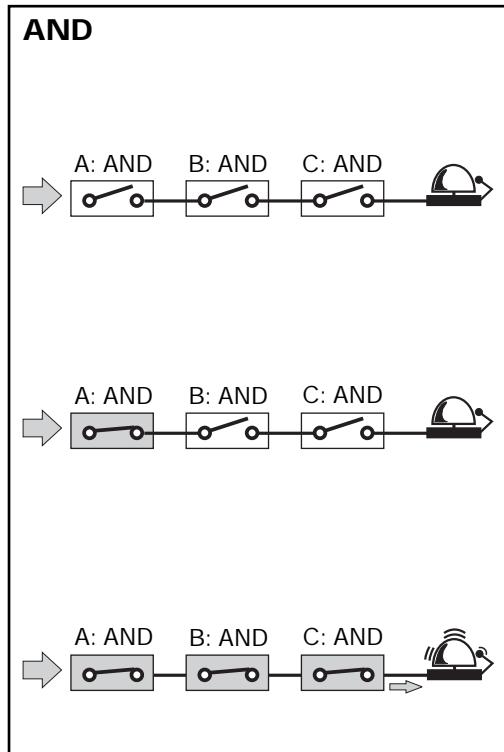


## Function Description

**Input and output scaling capability.** Working of the analogue outputs ( $y$ ) versus input variables ( $x$ )


**Figure A**

The sign of measured quantity and output quantity remains the same. The output quantity is proportional to the measured quantity.

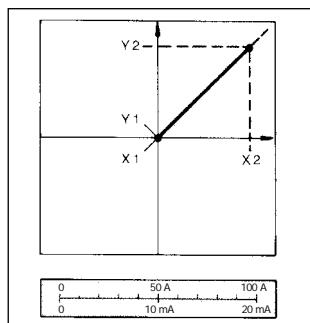


**Figure D**

The sign of measured quantity and output quantity remains the same. With the measured quantity being zero, the output quantity already has the value  $Y_1 = 0.2 Y_2$ . Live zero output.

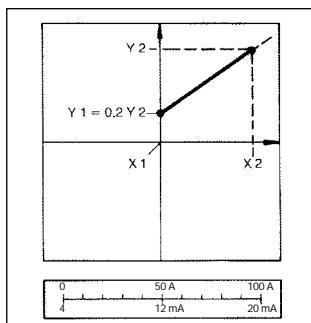


**Figure B**

The sign of measured quantity and output quantity changes simultaneously. The output quantity is proportional to the measured quantity.

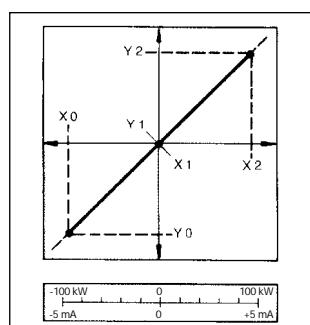


**Figure E**

The sign of the measured quantity changes but the one of the output quantity remains the same. The output quantity steadily increases from value  $X_1$  to value  $X_2$  of the measured quantity.

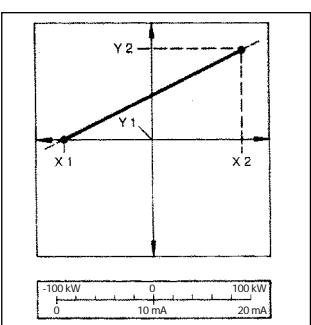


**Figure C**

The sign of measured quantity and output quantity remains the same. On the range  $X_0 \dots X_1$ , the output quantity is zero. The range  $X_1 \dots X_2$  is delineated on the entire output range  $Y_0 = Y_1 \dots Y_2$  and thus presented in strongly expanded form.

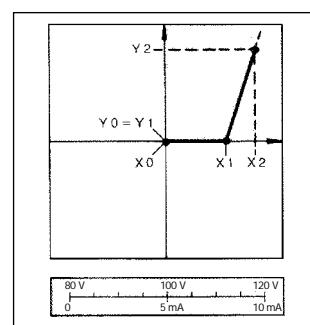

**Figure F**

The sign of the measured quantity remains the same, the one of the output quantity changes as the measured quantity leaves range  $X_0 \dots X_1$  and passes to range  $X_1 \dots X_2$  and vice versa.

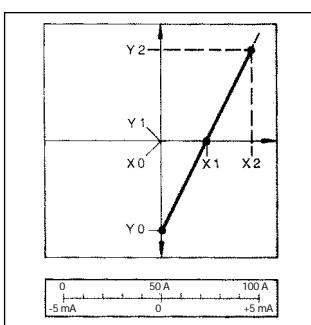

## Insulation between inputs and outputs

	Meas. /digital inputs	Relay output	Open collector output	Analogue out. 10V, 20mA	Analogue out. ±5mA	AR1034	AR2040	AR1039	Power Supply 90-260VAC/DC	Power Supply 18-60VAC/DC
Meas. /digital inputs	-	4kV	4kV	2kV	2kV	4kV	2kV	4kV	4kV	4kV
Relay output	4kV	4kV (*)	4kV	4kV	4kV	4kV	4kV	4kV	4kV	4kV
Open coll.out.	4kV	4kV	4kV (*)	4kV	4kV	4kV	4kV	4kV	4kV	4kV
Analogue out. 10V, 20mA	2kV	4kV	4kV	4kV (*)	4kV	4kV	4kV	4kV	4kV	4kV
Analogue out. ±5mA	2kV	4kV	4kV	4kV	200V (**)	4kV	4kV	4kV	4kV	4kV
AR1034	4kV	4kV	4kV	4kV	4kV	-	-	4kV	4kV	4kV
AR2040	2kV	4kV	4kV	4kV	4kV	-	-	4kV	4kV	4kV
AR1039	4kV	4kV	4kV	4kV	4kV	4kV	4kV	-	4kV	4kV
90-260VAC/DC	4kV	4kV	4kV	4kV	4kV	4kV	4kV	4kV	-	-
18-60VAC/DC	4kV	4kV	4kV	4kV	4kV	4kV	4kV	4kV	-	-

**NOTE:** In case of fault of first insulation the current from the measuring inputs to the ground is lower than 2 mA.

(\*) The given insulation is granted among outputs plugged in different slots. The modules equipped with two or four outputs have therefore non insulation among the outputs. (\*\*) Insulation between the 2 outputs of the same module is 200V for 1 min.


## Digital outputs important note

Code	Description	Slot A		Slot B		Slot C		Slot D	
A01058	1 relay output	A0		B0		C0		D0	
A01059	1 open coll. output	A0		B0		C0		D0	
A01035	2 relay outputs	A0	A1	B0	B1	C0	C1	D0	D1
A01036	2 open coll. outputs	A0	A1	B0	B1	C0	C1	D0	D1
A01037	4 open coll. outputs	A1	A2	A3	A4	B1	B2	B3	B4
						C1	C2	C3	C4
						D1	D2	D3	D4


The grey-marked digital outputs are activated for a while during the instrument start-up, therefore they are not suggested for pulse output purpose.

## Accuracy

kWh, accuracy (RDG) depending on the current

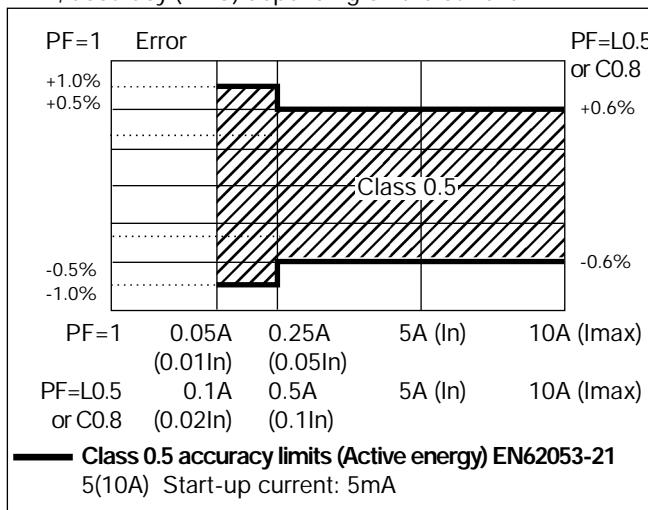

kvarh, accuracy (RDG) depending on the current

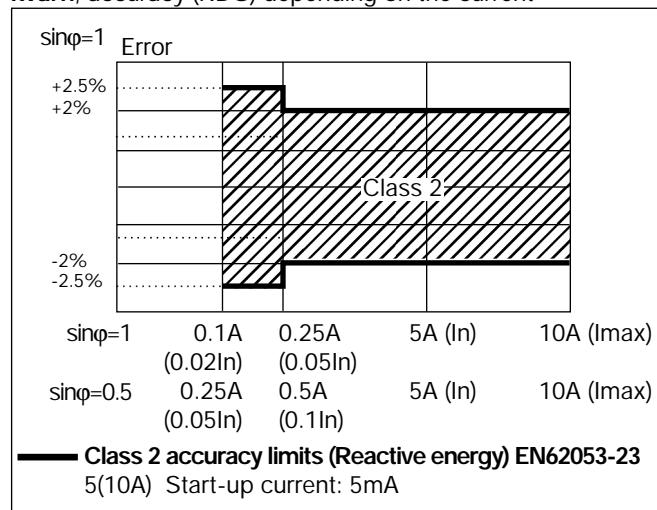

## Used calculation formulas

### Phase variables

Instantaneous effective voltage

$$V_{1N} = \sqrt{\frac{1}{n} \cdot \sum_1^n (V_{1N})_i^2}$$

Instantaneous active power

$$W_1 = \frac{1}{n} \cdot \sum_1^n (V_{1N})_i \cdot (A_1)_i$$

Instantaneous power factor

$$\cos\phi_1 = \frac{W_1}{VA_1}$$

Instantaneous effective current

$$A_1 = \sqrt{\frac{1}{n} \cdot \sum_1^n (A_1)_i^2}$$

Instantaneous apparent power

$$VA_1 = V_{1N} \cdot A_1$$

Instantaneous reactive power

$$VAR_1 = \sqrt{(VA_1)^2 - (W_1)^2}$$

### System variables

Equivalent three-phase voltage

$$V_\Sigma = \frac{V_{12} + V_{23} + V_{31}}{3}$$

Voltage asymmetry

$$ASY_{LL} = \frac{(V_{LL\max} - V_{LL\min})}{V_{LL\sum}}$$

$$ASY_{LN} = \frac{(V_{LN\max} - V_{LN\min})}{V_{LN\sum}}$$

Three-phase reactive power

$$VAR_\Sigma = (VAR_1 + VAR_2 + VAR_3)$$

Neutral current

$$An = \bar{A}_{L1} + \bar{A}_{L2} + \bar{A}_{L3}$$

Three-phase active power

$$W_\Sigma = W_1 + W_2 + W_3$$

Three-phase apparent power

$$VA_\Sigma = \sqrt{W_\Sigma^2 + VAR_\Sigma^2}$$

Three-phase power factor (TPF)

$$\cos\phi_\Sigma = \frac{W_\Sigma}{VA_\Sigma}$$

### Energy metering

$$kWh = \int_{t_1}^{t_2} P_i(t) dt \equiv \Delta t \sum_{n_1}^{n_2} P_{si}$$

$$kVarh = \int_{t_1}^{t_2} Q_i(t) dt \equiv \Delta t \sum_{n_1}^{n_2} Q_{si}$$

Where:

i = considered phase (L1, L2 or L3)

P = active power; Q = reactive power;

t<sub>1</sub>, t<sub>2</sub> = starting and ending time points of consumption recording; n = time unit; Δt = time interval between two successive power measurements;

n<sub>1</sub>, n<sub>2</sub> = starting and ending discrete time points of power recording

## List of the variables that can be connected to:

Analogue outputs (all variables with the only exception of energies), alarm outputs (all variables with the only exception of energies), pulse outputs (only energies), communication (all variables).

No	Variable	1-phase system	2-ph. 3-wire system	3-ph. 4-wire bal. (1 CT)	3-ph. 3-wire unbal. sys.	3-ph. 4-wire unbal. sys.	Notes
1	V L1	X	X	X	O	X	
2	V L2	O	X	X	O	X	
3	V L3	O	O	X	O	X	
4	V L-N sys	O	X	X	O	X	Sys = system = $\Sigma$
5	V L1-2	O	X	X	X	X	
6	V L2-3	O	O	X	X	X	
7	V L3-1	O	O	X	X	X	
8	V L-L sys	O	O	X	X	X	Sys = system = $\Sigma$
9	A L1	X	X	X	X	X	
10	A L2	O	X	X	X	X	
11	A L3	O	O	X	X	X	
12	An	O	X	X	O	X	An=neutral current
13	W L1	X	X	X	X	X	
14	W L2	O	X	X	X	X	
15	W L3	O	O	X	X	X	
16	W sys	O	X	X	X	X	
17	var L1	X	X	X	X	X	
18	var L2	O	X	X	X	X	
19	var L3	O	O	X	X	X	
20	var sys	O	X	X	X	X	Sys = system = $\Sigma$
21	VA L1	X	X	X	X	X	
22	VA L2	O	X	X	X	X	
23	VA L3	O	O	X	X	X	
24	VA sys	O	X	X	X	X	Sys = system = $\Sigma$
25	PF L1	X	X	X	X	X	
26	PF L2	O	X	X	X	X	
27	PF L3	O	O	X	X	X	
28	PF sys	O	X	X	X	X	Sys = system = $\Sigma$
29	Hz	X	X	X	X	X	
30	ASY VL-N	O	X	X	O	X	Asymmetry of phase-neutral
31	ASY VL-L	O	O	X	X	X	Asymmetry of phase-phase
32	THD V1	X	X	X	O	X	
33	THD V2	O	X	X	O	X	
34	THD V3	O	O	X	O	X	
35	THD V1-2	O	X	X	X	X	
36	THD V2-3	O	O	X	X	X	
37	THD V3-1	O	O	X	X	X	
38	THD A1	X	X	X	X	X	
39	THD A2	O	X	X	X	X	
40	THD A3	O	O	X	X	X	
41	THDo V1	X	X	X	O	X	
42	THDo V2	O	X	X	O	X	
43	THDo V3	O	O	X	O	X	
44	THDo V1-2	O	X	X	X	X	
45	THDo V2-3	O	O	X	X	X	
46	THDo V3-1	O	O	X	X	X	
47	THDo A1	X	X	X	X	X	
48	THDo A2	O	X	X	X	X	
49	THDo A3	O	O	X	X	X	
50	THDe V1	X	X	X	O	X	
51	THDe V2	O	X	X	O	X	
52	THDe V3	O	O	X	O	X	
53	THDe V1-2	O	X	X	X	X	
54	THDe V2-3	O	O	X	X	X	
55	THDe V3-1	O	O	X	X	X	
56	THDe A1	X	X	X	X	X	
57	THDe A2	O	X	X	X	X	
58	THDe A3	O	O	X	X	X	
59	Phase seq.	O	O	X	X	X	Phase sequence

(X) = available      (O) = not available






## Display pages

### Display variables in three-phase systems, 4-wire connections




No	1st variable	2nd variable	3rd variable	4th variable	Note
0	Selectable	Selectable	Selectable	See note	kWh + kvarh meters + W% bargraph
1	V L1	V L2	V L3	V L-N sys	instant.-min-max-dmd-max dmd
2	V L1-2	V L2-3	V L3-1	V L-L sys	instant.-min-max-dmd-max dmd
3	A L1	A L2	A L3	An	instant.-min-max-dmd-max dmd
4	W L1	W L2	W L3	W sys	instant.-min-max-dmd-max dmd
5	var L1	var L2	var L3	var sys	instant.-min-max-dmd-max dmd
6	VA L1	VA L2	VA L3	VA sys	instant.-min-max-dmd-max dmd
7	PF L1	PF L2	PF L3	PF sys	instant.-min-max-dmd-max dmd
8	V L1	A L1	PF L1	W L1	instant.-min-max-dmd-max dmd
9	V L2	A L2	PF L2	W L2	instant.-min-max-dmd-max dmd
10	V L3	A L3	PF L3	W L3	instant.-min-max-dmd-max dmd
11	V L-L sys	ASY V L-L	Hz	An	instant.-min-max-dmd-max dmd
12	V L-N sys	ASY V L-N	Hz	An	instant.-min-max-dmd-max dmd
13	W sys	var sys	PF sys	VA sys	instant.-min-max-dmd-max dmd
14	THD VL1 tot	THD VL2 tot	THD VL3 tot		instant.-min-max-dmd-max dmd
15	THD VL1 odd	THD VL2 odd	THD VL3 odd		instant.-min-max-dmd-max dmd
16	THD VL1 even	THD VL2 even	THD VL3 even		instant.-min-max-dmd-max dmd
17	THD VL1-2 tot	THD VL2-3 tot	THD VL3-1 tot		instant.-min-max-dmd-max dmd
18	THD VL1-2 odd	THD VL2-3 odd	THD VL3-1 odd		instant.-min-max-dmd-max dmd
19	THD VL1-2 even	THD VL2-3 even	THD VL3-1 even		instant.-min-max-dmd-max dmd
20	THD AL1 tot	THD AL2 tot	THD AL3 tot		instant.-min-max-dmd-max dmd
21	THD AL1 odd	THD AL2 odd	THD AL3 odd		instant.-min-max-dmd-max dmd
22	THD AL1 even	THD AL2 even	THD AL3 even		instant.-min-max-dmd-max dmd
23	Histogram FFT V1 (THD, THDo, THDe, Single harmonic)				
24	Histogram FFT V2 (THD, THDo, THDe, Single harmonic)				
25	Histogram FFT V3 (THD, THDo, THDe, Single harmonic)				
26	Histogram FFT V1-2 (THD, THDo, THDe, Single harmonic)				
27	Histogram FFT V2-3 (THD, THDo, THDe, Single harmonic)				
28	Histogram FFT V3-1 (THD, THDo, THDe, Single harmonic)				
29	Histogram FFT A1 (THD, THDo, THDe, Single harmonic)				
30	Histogram FFT A2 (THD, THDo, THDe, Single harmonic)				
31	Histogram FFT A3 (THD, THDo, THDe, Single harmonic)				
32	Digital input status				
33	Digital output status				
34	Energy meters				
35	Events				
36	Alarms status				
37	Info				
38	Info				
39	Info				

## Wiring diagrams




### 1-phase, 2-wire input connections (1P)

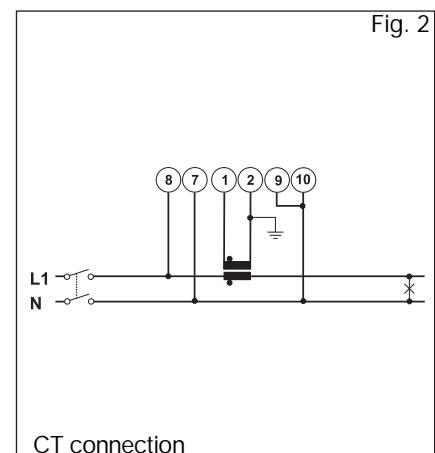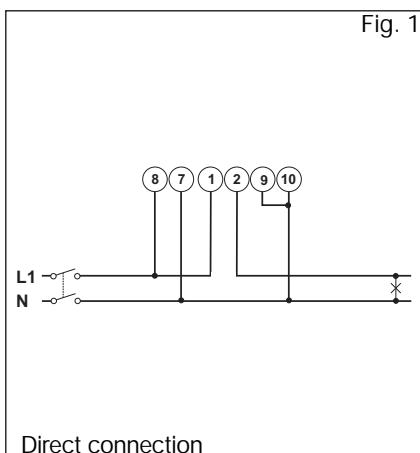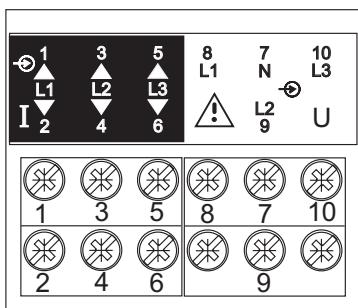

### 2-phase, 3-wire input connections (2P)

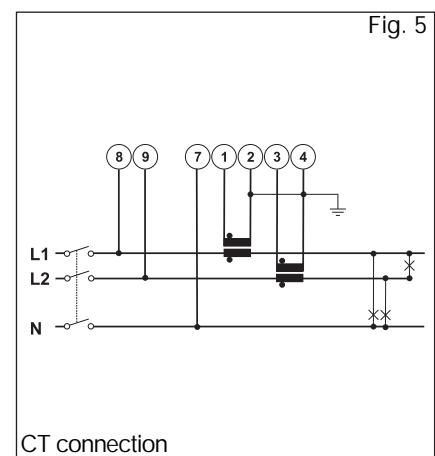
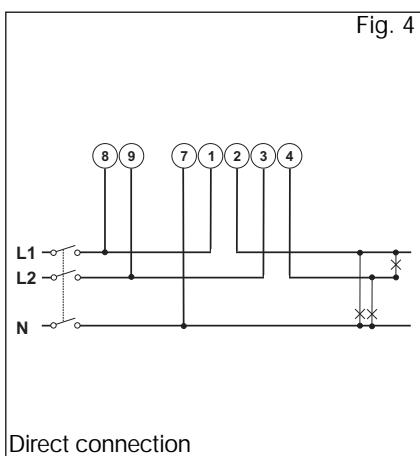
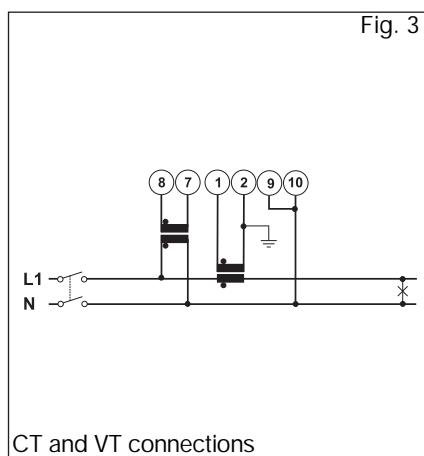


### 3-phase, 3 and 4-wire input connections - Balanced load (3P)

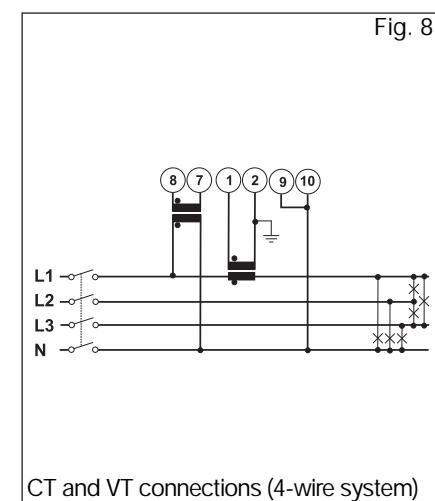
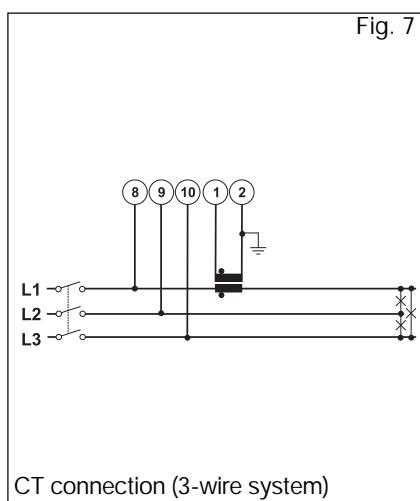
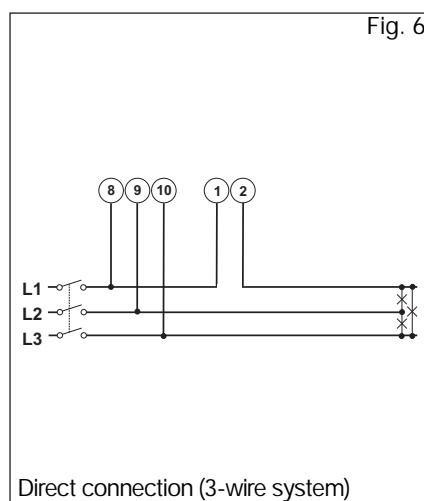


## Wiring diagrams (cont.)




### 3-phase, 3-wire input connections - Unbalanced load (3P)

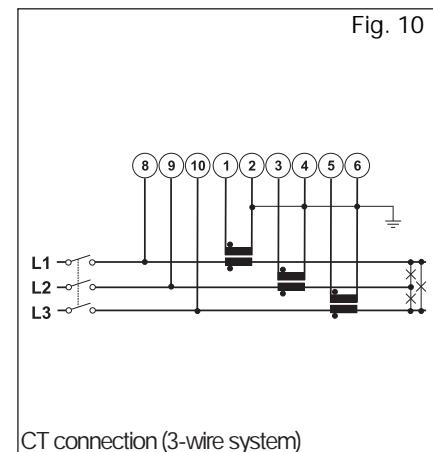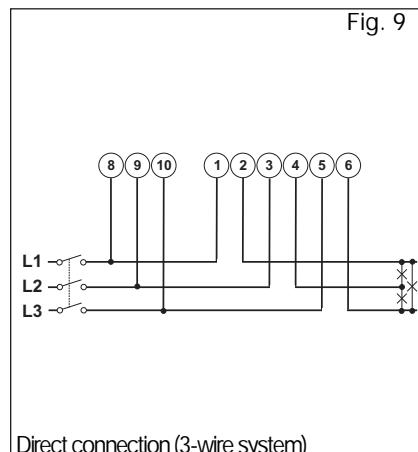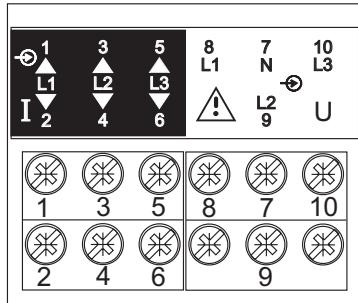


### 3-phase, 3-wire input connections ARON (3P)

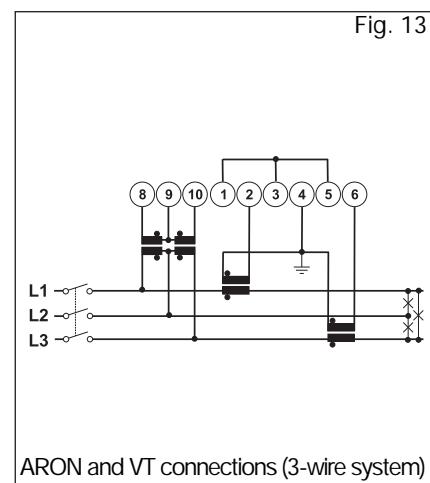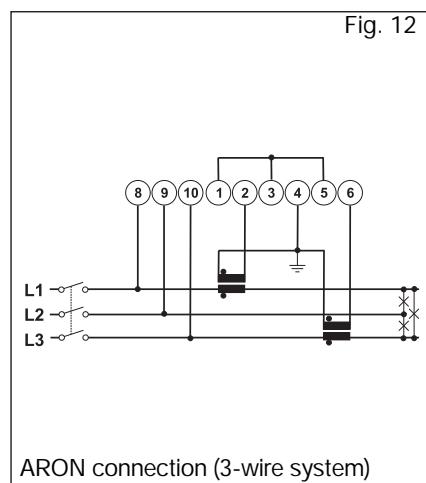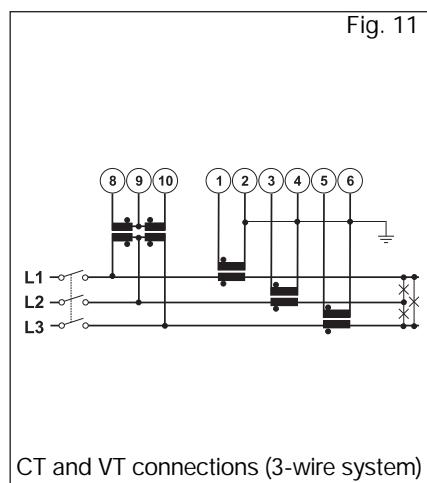


### 3-phase, 4 wires input connections - Unbalanced load (3p+N)

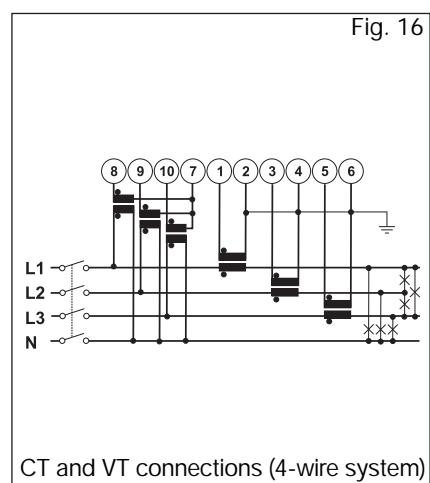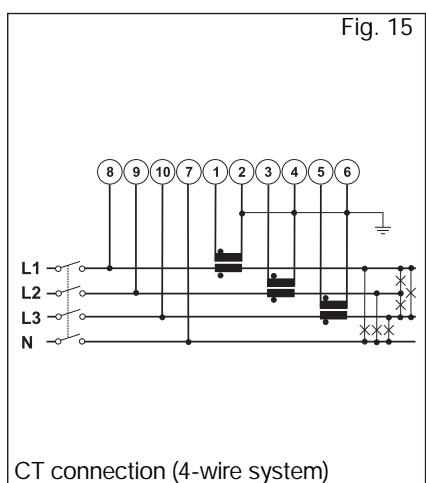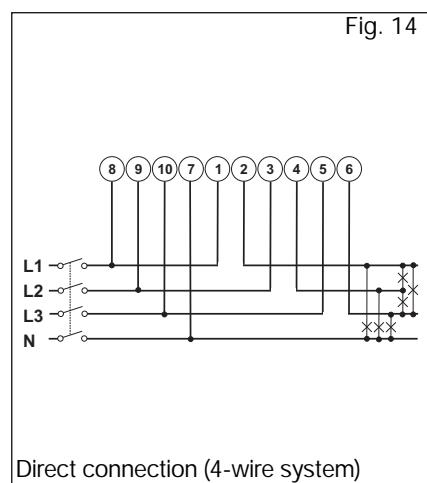


## Wiring diagrams (optional modules)




**AO2050**  
2 analogue  
outputs (0-20mA)




**AO2052**  
2 analogue  
outputs (+/-5mA)




**AO1051**  
2 analogue  
outputs (10V)

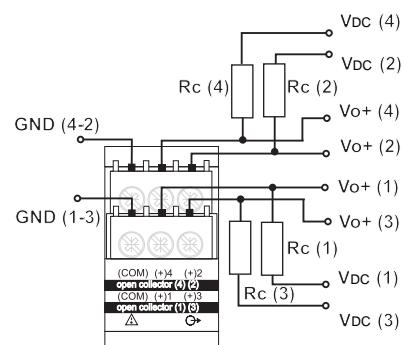


**AO1037** 4-open collector output connection:  
This wiring diagram is valid also for the open collector module with one or two outputs.  
The load resistances (RC) must be designed so that the close contact current is lower than 100mA; the VDC voltage must be lower than or equal to 30VDC.




**AO1058**  
1 relay output



**AO1035**  
2 relay outputs

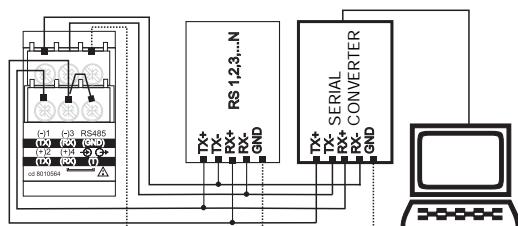


**AR1034/AR2040**  
4-wire connection of RS485 serial port

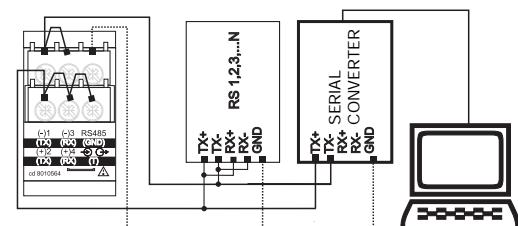

**AR1034/AR2040**  
2-wire connection of RS485 serial port



**RS422/485 NOTE:** additional devices provided with RS422/485 (that is RS 1, 2, 3...N) are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (RX+) and (T).

## Wiring diagrams: digital input modules

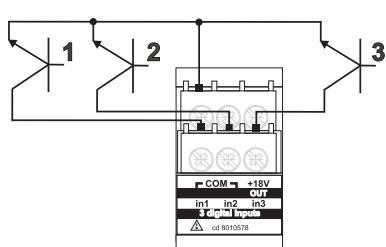


**AQ1042**  
Connection by  
means of NPN  
transistors.

**AQ1042**  
Connection by  
means of PNP  
transistors.

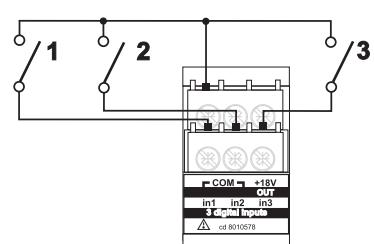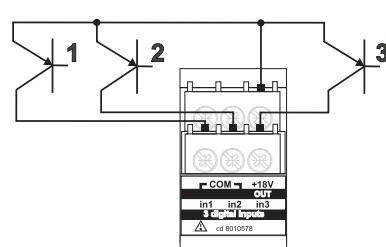


**AQ1042**  
Connection by  
means of con-  
tacts.

**AQ1038**  
Connection by  
means of con-  
tacts.



## Front panel description

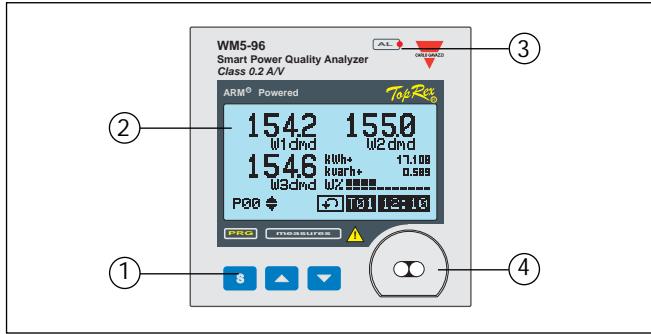

### 1. Key-pad

Set-up, programming and display parameters are easily controlled by the 3 push-buttons.

- **S** to enter programming and to confirm password.

### ▲ and ▼

- to program values
- to select functions
- to scroll display pages

### 2. Display

Instantaneous measurements:

- 4 digits (max display 9999)

Energies:

- 9 digits (max display 999 999 999).

Alphanumeric indications by means of LCD display for:

- Display of configuration parameters

- All measuring variables.


### 3. LED

Alarm LED.

### 4. Optical Port


For data reading and programming (or pulse output).

## Dimensions

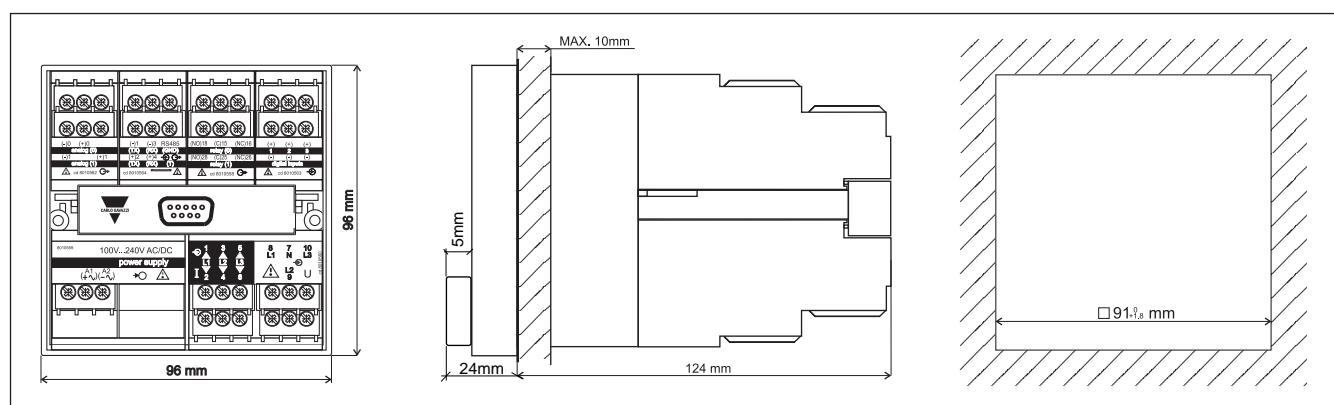


## Modules

### Dual analogue output modules




**AO2050** (20mADC)  
**AO2051** (10VDC)




**AO2052** (+/-5mADC)


### Digital output modules




**AO1058**  
Single relay output



**AO1035**  
Dual relay output




**AO1059**  
Single open collector output




**AO1036**  
Dual open collector output


### Other input/output modules




**AO1037**  
4 open collector outputs



**AQ1038**  
3 digital inputs




**AR1034**  
**AR2040**  
RS485 port




**AQ1042**  
3 digital inputs + aux

### Power supply modules



**AP1021**  
18-60VAC/DC power supply



**AP1020**  
90-260 VAC/DC power supply



**AR1039**  
RS232 port + RTC